

Techno-economic analysis of an air conditioning heat pump powered by photovoltaic panels and the grid

F. Aguilar^a, D. Crespi-Llorens^a, P.V. Quiles^a

Published in *Solar Energy* on 2019. DOI:10.1016/j.solener.2019.01.005.

© 2021. Manuscript version under the CC-BY-NC-ND 4.0 license.

^aDep. Ing. Mecánica y Energía. Universidad Miguel Hernández de Elche. Av. de la Universidad s/n (03202). Elche (Spain).

Abstract

This work presents an environmental and techno-economic study of an inverter air conditioner simultaneously powered by photovoltaic panels and the grid, without batteries. The unit provides the thermal demand to an office in an administrative building located in Alicante (South East Spain).

In comparison with other systems which also use renewable energy for air conditioning, this one presents significant advantages. It is comparatively simple, reliable, has low maintenance needs and its renewable energy production is entirely self-consumed, which avoids problematic interaction with the grid.

The system has been monitored during one year to measure the thermal energy provided to the room, the electrical consumption of the device and the photovoltaic and grid contribution to it.

Experimental results of some Key Performance Indicators are presented as a result of a one year data collection campaign. The measurements show a solar contribution of 54% to the electricity consumed by the system. As a result, the ratio between the thermal energy and grid electricity consumption during one year is $SPF_{sys} = 9.6$. Consequently, the primary non-renewable energy consumption is drastically reduced to a 26% of the reference system ($SPF_{ref} = 2.5$).

Furthermore, the techno-economic study concludes that in spite of requiring a higher initial investment in the system, the saving produced by the lower electricity consumption, results in an annualized cost of 84% of the reference system cost.

Keywords: photovoltaics, solar energy, air conditioning, renewable energy.

1 Nomenclature

2 E Energy.

3 LF Load factor.

4 P Power.

5 $PnRE$ Primary non renewable energy.

6 PEF_{EL} Primary energy factor for electricity.

7 Q Thermal energy provided by the air condi-
8 tioning, including cooling and heating

9 Key Performance Indicators

10 SPF_{unit}

11

12

13

14 SPF_{sys}

15

16

17

18 PER_{nRE}

19

20

21

22

23 PF

24

Seasonal performance factor for the air conditioning unit: ratio of useful heat and/or cold in relation to the electricity consumption needed.

Equivalent seasonal performance factor for the whole system. It indicates the grid electricity needed for supplying the thermal energy demand.

Primary non-renewable energy ratio. Relation between the non-renewable primary energy employed by the analysed system and by the reference system for the same energy demand.

Performance factor of the PV panels connected to the air conditioning unit.

Email address: dcrespi@umh.es (D. Crespi-Llorens)

Preprint submitted to *Solar Energy*

March 1, 2019

25	<i>FSAV</i>	Fraction savings of non-renewable primary	66
26		energy.	67
27	<i>SF</i>	Solar fraction or solar contribution to the	68
28		electricity consumed by the air conditioning	69
29		unit.	70
30	<i>CR</i>	Cost ratio. Ratio between the total annu-	71
31		alized cost of the analysed system and that	72
32		of the reference system for the same space	73
33		heating and cooling provided.	74
34	<i>C_{AN}</i>	Total annualized cost of the system.	75
35	<u>Subindex</u>		76
36	<i>ref</i>	Reference system.	77
37	<i>PV</i>	Photovoltaic panels.	78
38	<i>GD</i>	Grid.	79
39	<i>unit</i>	Air conditioning unit.	80
40	<i>sys</i>	The whole system including the PV panels	81
41		and the AC unit.	82
42	<i>PV, GD</i>	Refers to electrical energy or power pro-	83
43		duced by the three PV panels which are con-	84
44		nected directly to the grid.	85
45	<i>PV, unit</i>	Refers to electrical energy or power pro-	86
46		duced by the three PV panels connected to	87
47		the air conditioning unit.	88
48	<i>GD, unit</i>	Refers to electrical energy or power con-	89
49		sumed from the grid by the air conditioning	90
50		unit.	91
51	<i>TOT, unit</i>	Refers to the total electrical energy or power	92
52		consumed by the air conditioning unit.	93
53	<i>TOT, max</i>	Refers to the maximum total electrical en-	94
54		ergy or power which would be consumed by	95
55		the air conditioning unit if it was working at	96
56		full power during its working time.	97

57 1. Introduction

58 In 2015 in Paris, the United Nations Framework Con- 110
59 vention on Climate Change agreed to keep the increase 111
60 in global average temperature to well below 2°C above 112
61 pre-industrial levels, in order to reduce risks and the im- 113
62 pacts of climate change. Consequently, the European 114
63 Union has established the objective of a drastic cut of 115
64 80% of CO₂ emissions (referred to 1990) by 2050 . Be- 116
65 sides, individual goals and pathways have been set for 117

the different energy consuming sectors, the goal for the building sector being a 90% reduction, which includes the total decarbonization of this sector. With this aim, the use of renewable energy and electricity is proposed as substitution for fossil fuels in heating and cooling, which in developed countries accounts for half the energy use in buildings and one fifth of the total national energy use (Pérez-Lombard et al., 2008). Furthermore, the European Union has defined an intermediate general goal for 2030 of a 40% cut in CO₂ emissions, with at least a 32% share of renewable energy.

In addition to the need of emissions reduction, the increasing number of HVAC systems results in an increase of the grid electricity cost due to the high peak demands (Passey et al., 2018). Under these circumstances, there is significant research activity focused on reliable and environmental friendly solutions for HVAC systems. Back in 2007, Balaras et al. (2007) made a review of solar air conditioning systems in Europe and Henning (2007) drew a picture about general issues for using solar thermal energy for the air conditioning of buildings. More recently, Al-Alili et al. (2014) and Zouaoui et al. (2017) focused their works on solar activated solid desiccant cooling technologies. Several authors (Izquierdo et al., 2011; Huang et al., 2011; Allouhi et al., 2015; Al-Ugla et al., 2016) studied the economic feasibility of different types of solar air conditioning systems.

Through a systematic literature research, Sampaio and González (2017) analysed the current situation of photovoltaic solar energy, and pointed out the main advantages which make it a good solution for use in buildings: high reliability, availability, low maintenance needs and its potential to mitigate emissions of greenhouse gases. In fact, solar cooling and heating systems are increasing consistently in number and available technologies (Mugnier et al., 2017). Among them, the use of photovoltaic panels is actively studied. Li et al. (2015) carried out experiments during one day and night in winter and summer to demonstrate that consistent and reliable heating and cooling could be achieved by a PV and grid powered air conditioner with batteries in the cold winter as well as in the hot summer of Shanghai (China). They also pointed out that this system could be a good solution to reduce the peak loads in the electrical grid during such periods. Huang et al. (2016) studied the operation of small scale air conditioning systems powered by PV and batteries when varying the air conditioning unit model, the number of panels and the battery capacity. The study was made for several typical days. Liu et al. (2017) investigated an air conditioner driven by a quasi grid-connected photovoltaic (PV) system powered

during one day in July in Beijing (China). The analysis was carried out for the system with batteries and without them. They quantified the potential energy savings of more than 67% and 77% during summer daytime and night-time. Varga et al. (2017) reported their first experimental results with a small scale solar driven ejector cooling system installed in Porto, Portugal. Xu et al. (2018) applied ice thermal storage air-conditioning and photovoltaic air-conditioning in the refrigeration field. Their analysis showed that it is feasible to use ice thermal storage instead of a battery bank to store solar energy in the field of distributed photovoltaic refrigeration.

A previous work by the authors (Aguilar et al., 2017) tested a heat pump in cooling mode powered by photovoltaic panels and the electrical grid during the hot season in Spain. The cooling system was installed in an office and the solar contribution and the production factor were found to be both 65%. Recently, Opoku et al. (2018) studied the performance of a hybrid solar PV(with batteries)–grid powered air–conditioner for daytime office cooling in hot humid climates (Kumasi, Ghana) during one year. Li et al. (2018) analysed the annual performance of a chiller water plant powered by 1562 PV panels used to provide cooling (April to November) to a 14220 m² tertiary building and measured an annual solar fraction of 52%, even when no cooling was generated during the four winter months.

Our literature search has yielded only two experimental works dealing with PV powered air conditioning devices which have been tested throughout one year (Opoku et al., 2018; Li et al., 2018). On the one hand, the study by Opoku et al. (2018) is particular to the hot humid climate in Ghana, as the device only works in cooling mode throughout the year and with a very high demand throughout the day. This situation is very different to the one in an office in Europe, where there are cooling and heating demands throughout the year and the demand varies significantly throughout the day. On the other hand, the work by Li et al. (2018) is focused in a large tertiary building, which is only provided with cooling. The weather conditions of this study are similar to the ones of the mediterranean climate, however, the conclusions of the work would not be applicable to the small tertiary sector working with heat pumps which provide heating and cooling through the year.

Furthermore, the lack of knowledge and economic reasons are pointed out as the main obstacles for a wider spread of this technology (Mugnier et al., 2017).

In view of this situation the present study was undertaken. It presents an experimental study in a real situation, which uses solar energy and grid electricity to pro-

Table 1: Air conditioner technical data

Midea Solar 3D	Unit	Nom.
Cooling capacity	kW	3.52
Cooling power supply	kW	0.86
EER	—	4.09
Heating capacity	kW	3.81
Cooling power supply	kW	0.99
COP	—	3.83
Refrigerant	R410A	

vide an office with cooling and heating for one year. By the use of solar energy and an efficient heat pump, the use of primary energy and CO₂ emissions are drastically reduced and, at the same time, the direct use of fossil fuels is avoided. The office is located in Alicante (South East Spain), where the climate is Mediterranean, which is characterised by moderate winters and hot summers. The study, focused on the annual performance of the system, is aligned with the European objective of CO₂ emission reduction, the use of renewable energies, decarbonization and the objective of developing solutions towards nearly zero energy buildings (nZEB). The work analyses parameters such as the solar contribution, the grid electricity savings, the use of non-renewable primary energy and the CO₂ emissions. Besides, the annual cost of the system during its lifetime is quantified and compared to a reference system.

2. Experimental setup

A 35 m² office in an administrative building was provided with cooling and heating throughout one year by using a highly efficient heat pump. The working time of the office was from 8h to 20h from Monday to Friday and from 8h to 14h on Saturday. The characteristics of the air conditioning unit (AC) are detailed in Table 1. For the study, the temperature was set to 23°C in summer and 21°C in winter within the office. The system control was configured to meet the demand.

A sketch of the system (PV panels + AC unit) is shown in Figure 1. There were three 235 W_p photovoltaic panels located on the roof of the building, with an inclination of 30° (latitude of 38°) and with an azimuth deviation of 15° from South. The AC unit was connected both to the conventional grid (230 V_{ac}) and to the PV panels (24 V_{dc}). Both energy sources work in parallel and they are summed in order to supply the total electrical energy demanded by the air conditioning unit (Figure 2). So, this air-conditioner has always enough

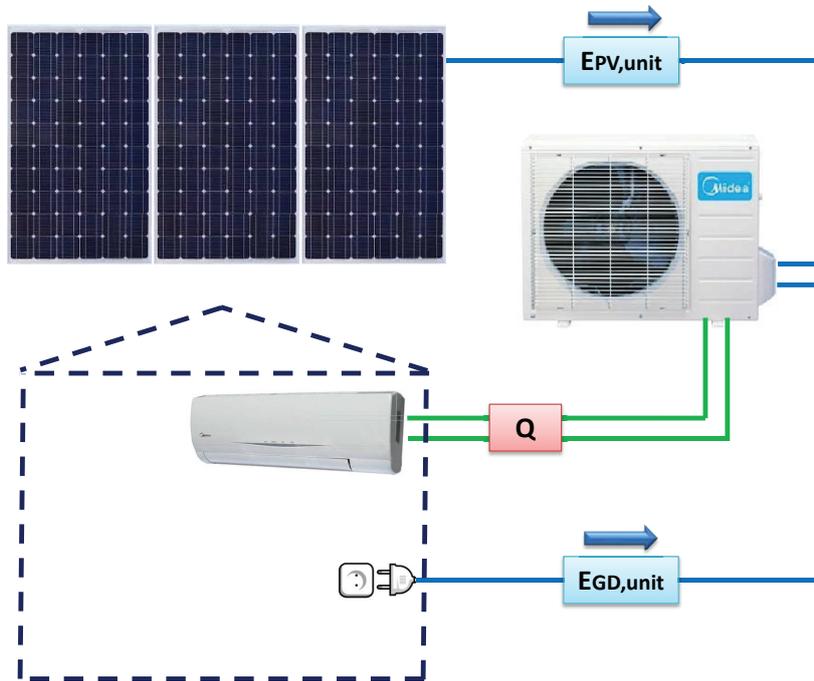


Figure 1: Sketch of the air conditioning system energy flows.

207 energy to work properly, regardless of the solar irradiation
 208 variations. This unit has an inverter that transforms
 209 grid energy from 230 V_{AC} at 50 Hz to $200 - 300\text{ V}_{\text{DC}}$ to
 210 drive a compressor at different angular velocities. The
 211 PV energy integration occurs before connection to the
 212 compressor through a converter that operates between
 213 24 V_{DC} and $200 - 300\text{ V}_{\text{DC}}$. While PV power output
 214 is sufficient and due to the difference in impedance be-
 215 tween the two energy sources (PV and the grid), PV
 216 power becomes the lead energy source. Grid power is
 217 only absorbed once PV power is insufficient.

218 As it can be observed in Figure 3, three additional
 219 and identical PV panels were connected to the electri-
 220 cal grid through a maximum power point (MPP) grid
 221 converter. The purpose was to measure the potential
 222 maximum production of the panels. Consequently, the
 223 influence of the air-conditioning equipment on the PV
 224 panels production could be evaluated. The figure also
 225 shows details of the data collection carried out by an
 226 Agilent 34972A data-logger with a 5 minute time step.
 227 The room and outside ambient temperatures were mea-
 228 sured with type-K thermocouples. The refrigerant cycle
 229 parameters were measured by four thermocouples and
 230 two manometers. Two shunt resistances were used to
 231 evaluate the current consumed by the air conditioning
 232 device both from the grid and from the PV panels, while

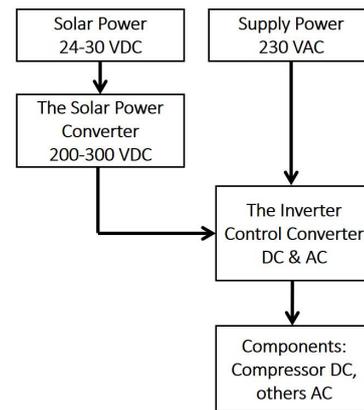


Figure 2: AC unit power supply connection diagram.

a third one was used for the PV panels connected to the grid. A network analyser Chauvin Arnoux CA 8334 was in charge of registering power consumption from the compressor. Furthermore, a meteorological station registered humidity, wind, wind direction and solar irradiation.

Further details of this experimental setup and procedure can be found in (Aguilar et al., 2017), where detailed results in cooling mode are provided.

3. Results

During the experimental campaign, data corresponding to more than two hundred and fifty days (at least 20 days every month) were collected. These results have been used to obtain conclusions about the seasonal behaviour of the system.

3.1. Daily results

In order to understand the behaviour of the system, two typical days, one in cooling and one in heating modes, are described in detail in this section.

Figure 4 shows the curves of the electrical parameters registered in a day of July, including: the power supplied from the PV panels to the air-conditioning unit ($P_{PV,unit}$), the power supplied from the grid to the unit ($P_{GD,unit}$) and the total power consumed by the unit ($P_{TOT,unit}$), which is the sum of the two previous curves. The 3 reference PV panels were measured and their power curve has been included ($P_{PV,GD}$) in the figure as well.

As it can be seen in the figure, the unit was working for 12 hours, between 8 a.m. to 8 p.m. Nevertheless, since the power $P_{PV,unit}$ depends on both the electrical consumption and the solar irradiation, four working points are analysed in the following paragraphs.

At point A, the electrical power consumed by the unit ($P_{TOT,unit}$) was higher than the PV panels potential electricity production, so that the PV power was not enough to feed the AC unit and the rest was supplied by the grid. In this case, the PV panels connected to the unit supplied almost the same power than those connected to the grid. The only power loss was due to the lower efficiency of the unit converter which is not an MPP converter. This power loss can be better appreciated at point B, when the situation was similar to point A.

On the contrary, at point C the electrical power demand of the air-conditioning unit ($P_{TOT,unit}$) was significantly lower than the PV panels potential electricity production ($P_{GD,unit}$). Consequently, the unit converter which controls the PV panels, modified their working

point in order to match the electrical power demand ($P_{PV,unit} = P_{TOT,unit}$). It can be seen that the reference PV panels went on working according to the maximum power point, so that the $P_{PV,GD}$ was much higher than $P_{PV,unit}$. In this situation, the power consumption from the grid became almost zero.

Finally, at point D the solar irradiation was decreasing and the system worked as it did at point A.

At 8 p.m. the unit and the PV panels connected to it turned off. However, the PV panels connected to the grid went on working until 9 p.m. because of the available solar irradiation.

The energy supplied by the grid ($E_{GD,unit}$), the energy supplied by the PV panels ($E_{PV,unit}$) and the energy produced by the reference PV panels ($E_{PV,GD}$) have been calculated out of the measured power and the time elapsed between measurements, Δt . The total energy consumed by the unit $E_{TOT,unit}$ is calculated as the sum of $E_{GD,unit}$ and $E_{PV,unit}$. All these results have been included in Figure 4.

As is explained in (Aguilar et al., 2017) the useful thermal energy supplied to the office can be calculated by using the refrigerant method (Tran et al., 2012). In the studied day of July, the useful energy was $Q = 29.11$ kWh.

Figure 5 shows the curves of the electrical parameters registered in a day of February. As previously, 4 typical working points have been highlighted.

On the one hand, it can be seen that in points E, F and G the system has the same behaviour than in points A, C and D, of Figure 4, respectively.

On the other hand, in point H both the energy produced by the PV panels connected to the unit and the energy produced by the PV panels connected to the grid is zero because the sunset in winter is before 8 p.m ($P_{GD,unit} = P_{TOT,unit}$).

Several key performance indicators (KPIs) have been defined in order to compare the unit behaviour among the different studied periods. In this section, these KPIs have been calculated for 1 day period.

First of all, the Seasonal Performance Factor of the unit (SPF_{unit}) is defined as the ratio of the useful thermal energy and the total electricity consumed.

$$SPF_{unit} = \frac{Q}{E_{TOT,unit}} \quad (1)$$

The SPF_{unit} represents the performance in the working conditions, of the air conditioning unit only. In order to evaluate the performance of the whole system, including the panels, the equivalent seasonal performance factor for the system has been obtained.

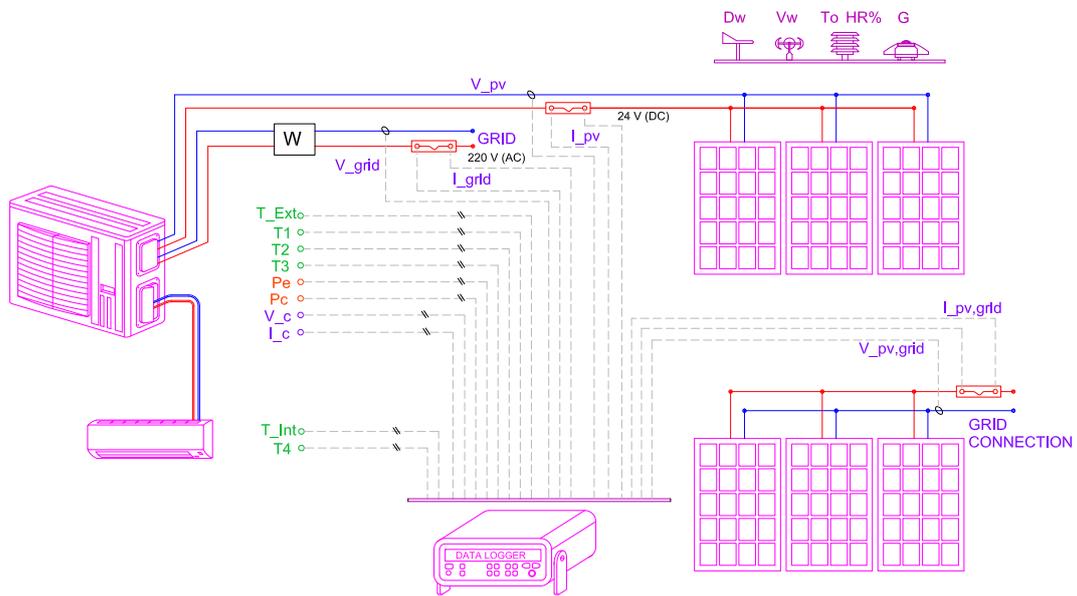


Figure 3: Experimental setup. Monitorization details.

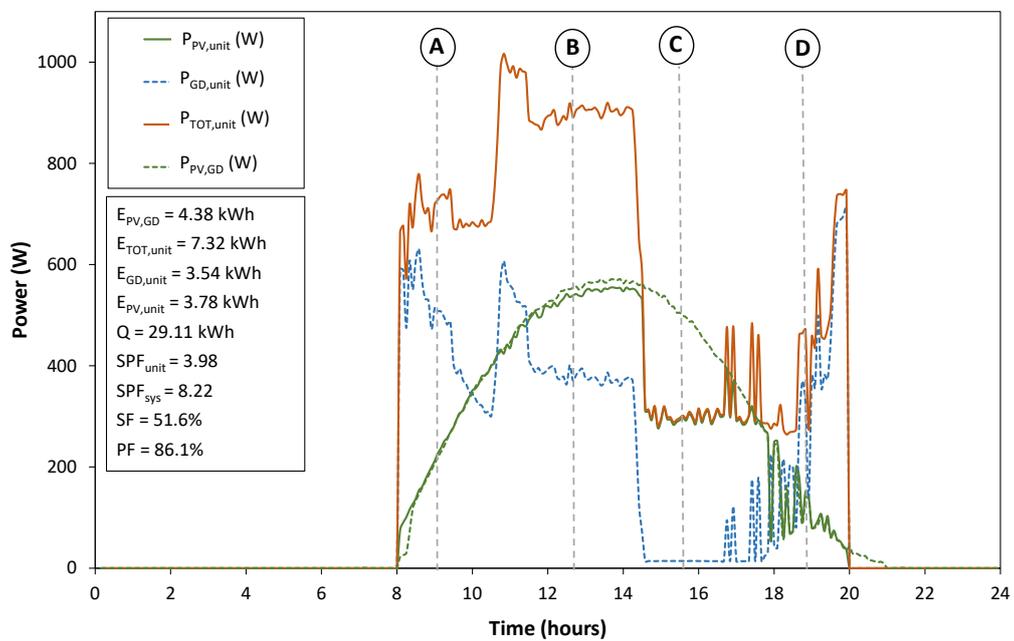


Figure 4: Electrical curves registered along one day in July: ($T_{out} = 30.2$ °C, $I = 7.61$ kWh/m², $LF = 61.0\%$).

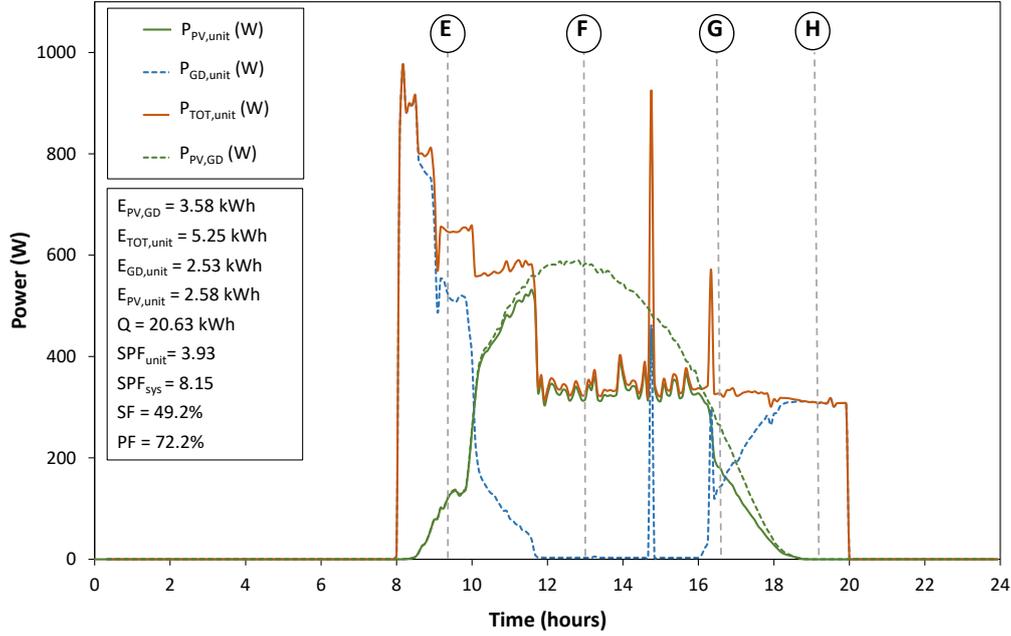


Figure 5: Electrical curves registered along one day in Feb: ($T_{out} = 12.5\text{ }^{\circ}\text{C}$, $I = 5.72\text{ kWh/m}^2$, $LF = 43.8\%$).

$$SPF_{sys} = \frac{Q}{E_{GD,unit}} \quad (2)$$

329 So defined, the SPF_{sys} indicates the grid electricity
 330 needed for supplying the energy demand. This param-
 331 eter can be considered like a mean COP or EER of the
 332 system, but in working conditions.

333 The solar fraction is defined as the ratio of the elec-
 334 tricity produced by the PV panels and the total con-
 335 sumed by the air conditioner.

$$SF (\%) = \frac{E_{PV,unit}}{E_{TOT,unit}} \quad (3)$$

336 For its part, the Production Factor (PF) takes into
 337 consideration the solar energy losses due to the fact that
 338 the PV panels connected to the air conditioning unit fol-
 339 lowed its electrical demand instead of using an MPP
 340 converter. This KPI is defined as follows:

$$PF (\%) = \frac{E_{PV,unit}}{E_{PV,GD}} \quad (4)$$

341 These KPIs, which have been calculated for these two
 342 days, have been included into Figure 4 and Figure 5,
 343 respectively.

344 Finally, the Load Factor (LF) allows to know the ratio
 345 between the real energy consumed by the unit and the
 346 maximum energy consumed if the unit was working at

347 100% power, during the 12 h test period ($E_{TOT,max} =$
 348 12 kWh).

$$LF (\%) = \frac{E_{TOT,unit}}{E_{TOT,max}} \quad (5)$$

3.2. Annual results

350 The results of the system performance throughout
 351 one year are analysed in this section. The KPIs de-
 352 fined in previous section will be calculated monthly,
 353 seasonally and annually. The unit was working in heat-
 354 ing mode from November to April and in cooling mode
 355 from May to October, the system control being config-
 356 ured to meet the thermal demand. All the results for this
 357 section are detailed in Table 2.

358 Firstly, the performance of the AC unit is analysed.
 359 Figure 6 shows the total electricity absorbed by the air
 360 conditioning unit month by month. The thermal energy
 361 (heat or cold) provided to the office is shown in the fig-
 362 ure as well. Out of this data, the seasonal performance
 363 factor of the AC unit (SPF_{unit}) has been obtained (Eq. 1)
 364 and plotted in the Figure as well.

365 The results show that the highest demand occurs in
 366 January in heating mode and in July in cooling mode, as
 367 it is expected for this climate. The resulting SPF_{unit}
 368 of the air conditioning unit for the year has been 4.44. Bet-
 369 ter performance of the unit is observed for months with
 370 lower demand, when the machine is working at partial
 371 loads and the climate conditions are moderate. Besides,

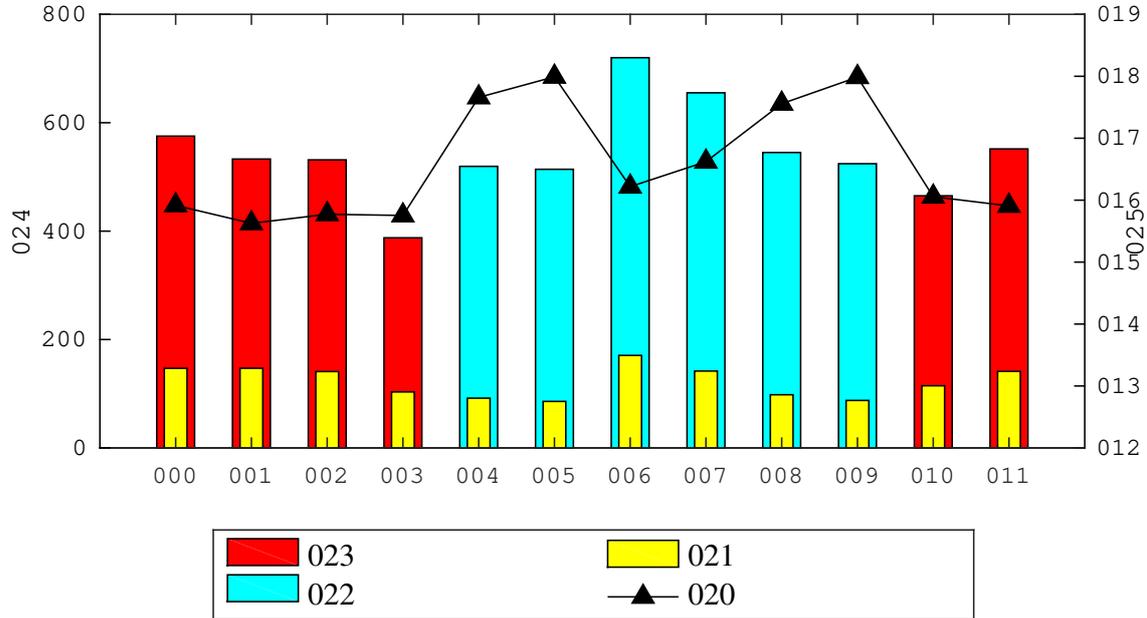


Figure 6: Total energy consumed $E_{TOT,unit}$ (electrical) and produced Q (thermal) by the air conditioning unit. Seasonal performance factor of the unit (right axis).

the obtained SPF_{unit} of 5.34 in cooling mode is higher than the one in heating mode, 3.84.

The contribution of the PV panels is evaluated next.

Figure 7 shows the electricity consumed by the air conditioning unit from the PV panels ($E_{PV,unit}$) and from the grid ($E_{GD,unit}$).

The solar fraction is shown in Figure 8. The low demand in spring and autumn and moderate solar resource result in solar fractions up to 78% (Table 2). During the hottest months of the year, July and August, the solar fraction drops to 56%-59% due to the high cooling demand (high LF), despite being the sunniest months. Lower values of the solar contribution are found from December to March where the thermal demand is also significant (heating) and, besides, the solar irradiation reaches its minimum.

The overall SPF_{sys} for the year, which evaluates the performance of the whole system, including the panels, is 9.61. The results in Figure 9 show better ratios during months with moderate climate, where the working conditions for the unit are more favourable and the solar fraction is higher. Besides, the SPF_{sys} in heating conditions is 6.93 on average, while in cooling conditions it is 14.54, 110% higher. This difference is partly explained due to the better SPF_{unit} in cooling mode, but also due to the higher solar irradiation available during the hot

months, which results in lower grid electricity demand.

As has been commented before, the PV panels connected to the air conditioner do not produce as much energy as if they were connected to the grid.

The results for the performance factor PF (Eq. 4), defined as the ratio between the PV panels energy production and their maximum production if they were connected to the grid, are shown in Fig. 8. The highest performance factor values are obtained from November to February (up to 92%). During this period, irradiation is low and the thermal needs are high enough to make the most of it. In July and August, the thermal needs are high as well, but more irradiation is available during longer periods each day, which results in a higher waste of energy (PF between 73% and 74%). However, the highest waste takes place during months with low thermal needs: April and May (cooling), June and October (heating). The result for the year is an average performance of 70%.

4. Environmental benefits

In this section the environmental benefits of the PV powered air conditioning system are evaluated. With that aim, two different system configurations are studied. One of them consist of an highly efficient AC unit

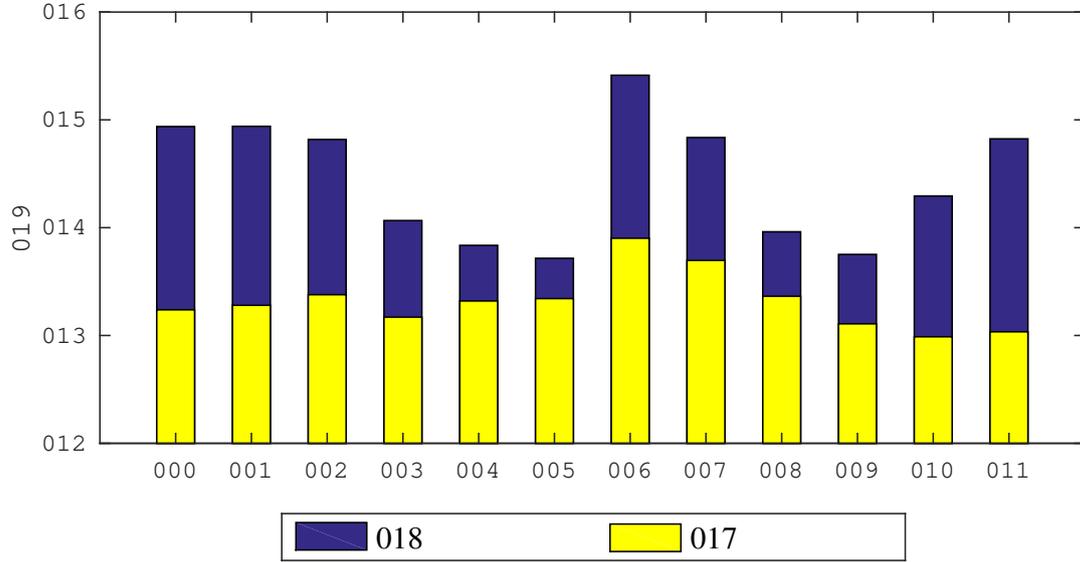


Figure 7: Electrical consumption ($E_{TOT,unit}$) broken down according to the energy source: the grid ($E_{GD,unit}$) or the PV panels ($E_{PV,unit}$)

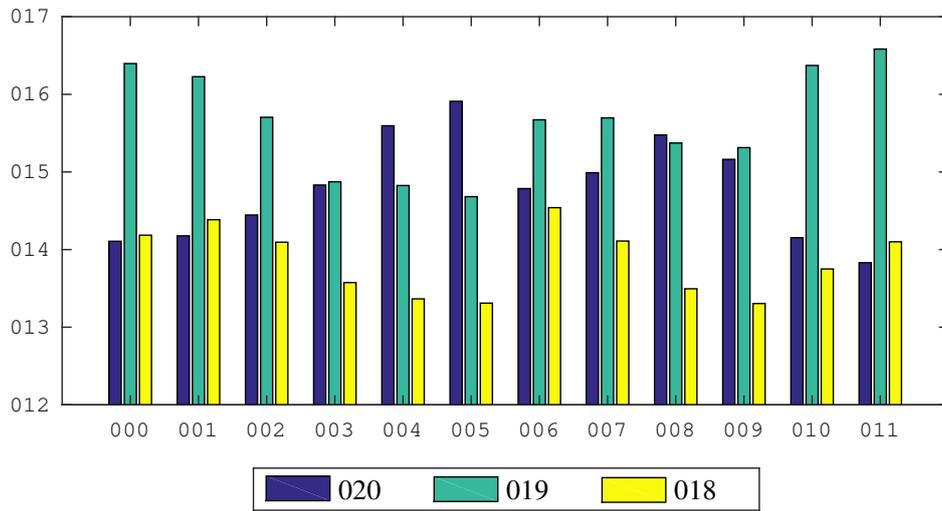


Figure 8: Solar fraction SF , Performance factor PF and Load factor LF .

Table 2: Energy flow data of the HVAC system. All energy values are given in kWh. The unit provides cooling from May to October and heating from November to April.

Nomenc.	EPV,GD	EPV,unit	EGD,unit	ETOT,unit	Q	SPFunit	SPFsys	SF(%)	PF(%)	LF(%)	TEXT(°C)	HQ(kWh/m ² day)
May	116,8	66,0	25,8	91,8	519,5	5,66	20,10	71,9	56,5	27,3	24,0	6,56
Jun	125,1	67,1	18,7	85,8	514,1	5,99	27,50	78,2	53,6	26,2	26,8	7,28
Jul	129,5	95,1	75,6	170,7	720,0	4,22	9,52	55,7	73,4	50,8	31,1	7,35
Aug	114,7	84,8	57,0	141,8	655,2	4,62	11,50	59,8	73,9	42,2	30,6	6,56
Sep	101,1	68,2	29,9	98,1	545,1	5,56	18,20	69,5	67,5	29,9	27,8	6,04
Oct	83,6	55,4	32,2	87,6	524,4	5,99	16,30	63,2	66,3	26,1	26,1	4,91
Cooling	670,8	436,6	239,2	675,8	3478,3	5,15	14,50	64,6	65,1	33,8	27,1	6,45
Nov	56,5	49,4	65,3	114,7	465,2	4,06	7,12	43,1	87,4	35,0	14,9	3,47
Dec	56,4	51,7	89,5	141,2	551,7	3,91	6,16	36,6	91,7	42,0	15,2	3,35
Jan	70,4	61,9	85,0	146,9	575,3	3,92	6,77	42,1	87,9	43,7	15,1	4,15
Feb	75,7	64,0	83,0	147,0	533,0	3,63	6,42	43,5	84,5	47,7	13,6	4,85
Mar	93,0	68,9	72,0	140,9	531,5	3,77	7,38	48,9	74,1	41,9	16,8	5,30
Apr	101,8	58,5	44,8	103,3	387,7	3,75	8,65	56,6	57,5	31,5	19,1	5,93
Heating	453,8	354,4	439,6	794,0	3044,4	3,83	6,93	44,6	78,1	40,3	15,8	4,50
Year	1124,6	791,0	678,8	1469,8	6522,6	4,44	9,61	53,8	70,3	37,0	21,7	5,48

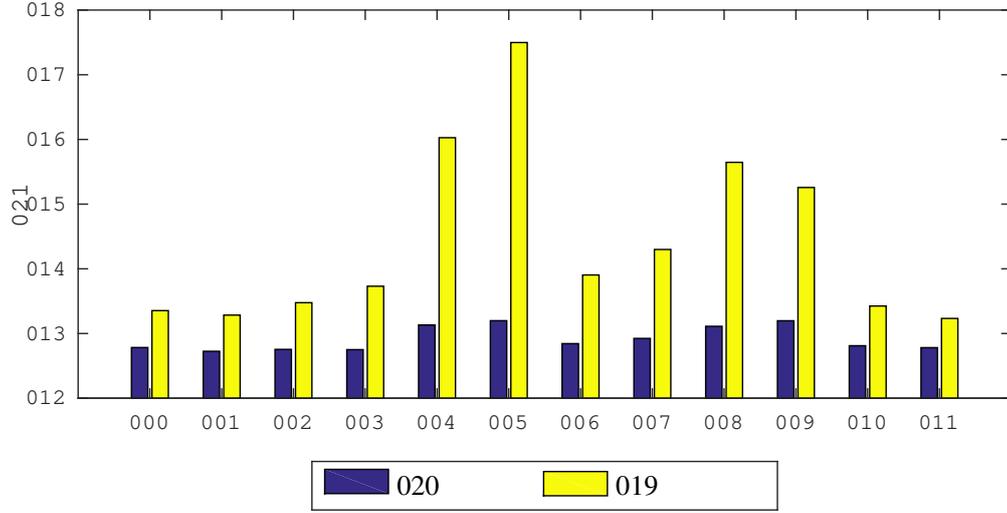


Figure 9: Seasonal performance factor for the unit (SPF_{unit}) and the system (SPF_{sys}).

422 powered by three PV panels and the grid and the other
 423 consist of the same unit powered only by the grid. The
 424 results will be compared to those of a reference system.
 425 Usually, a gas boiler for space heating and an air
 426 conditioning unit for space cooling are considered as the
 427 reference system. However, this is an expensive solu-
 428 tion, which is not often used for offices in the Mediter-
 429 ranean region. Therefore, in this study, the reference
 430 system consists in a reversible air conditioner for heat-
 431 ing and cooling, which is a very common solution for
 432 this climate. The unit is considered to have a seasonal
 433 efficiency of 2.5 (cooling and heating). The proposed
 434 comparison allows us to evaluate separately the bene-
 435 fits of installing a more efficient heat pump and the PV
 436 panels.

437 Firstly, the environmental benefits of the analysed
 438 systems are evaluated in terms of primary energy con-
 439 sumption and CO₂ emissions reduction.

440 As electricity is the final energy consumed by all
 441 the systems under consideration, their primary non-
 442 renewable energy is computed by using the conversion
 443 factor for this type of final energy (PEF_{EL} in Table 3):

$$PnRE = \frac{Q}{SPF} PEF_{EL} \quad (6)$$

444 The *primary energy ratio*, indicates the relation be-
 445 tween the non-renewable primary energy employed by
 446 the analysed system and by the reference for the same
 447 energy demand. For this case, where the final energy
 448 consumed by the system and the reference is electricity,
 449 the ratio is reduced to the following

Table 3: Reference system efficiency and energy conversion factors for Spain (IDAE, 2016).


	value	units
SPF_{ref}	2.5	
PEF_{EL}	2.0	kWh _{PnRE} /kWh _e
Emissions factor	0.357	gCO ₂ /kWh _e

$$PER_{nRE} = \frac{PnRE_{ref}}{PnRE_{sys}} = \frac{SPF_{sys}}{SPF_{ref}} \quad (7)$$


450 The *savings fraction* of non-renewable primary en-
 451 ergy, indicates the percentage of non-renewable pri-
 452 mary energy consumption.

$$FSAV (\%) = \frac{PnRE_{ref} - PnRE_{sys}}{PnRE_{ref}} \quad (8)$$

453 The results plotted in Figure 10 show the convenience
 454 of using an efficient heat pump instead of the reference
 455 system. The annual primary energy ratio for the system
 456 without PV panels is 1.78, meaning that the reference
 457 consumes 1.78 times more non-renewable primary en-
 458 ergy than this system. This results in annual savings
 459 of 44% of the primary non-renewable energy. Further-
 460 more, the use of the PV panels boost the savings of pri-
 461 mary non-renewable energy. With a PER of 3.84, the
 462 system powered with PV panels achieves an annual sav-
 463 ing of 74%.

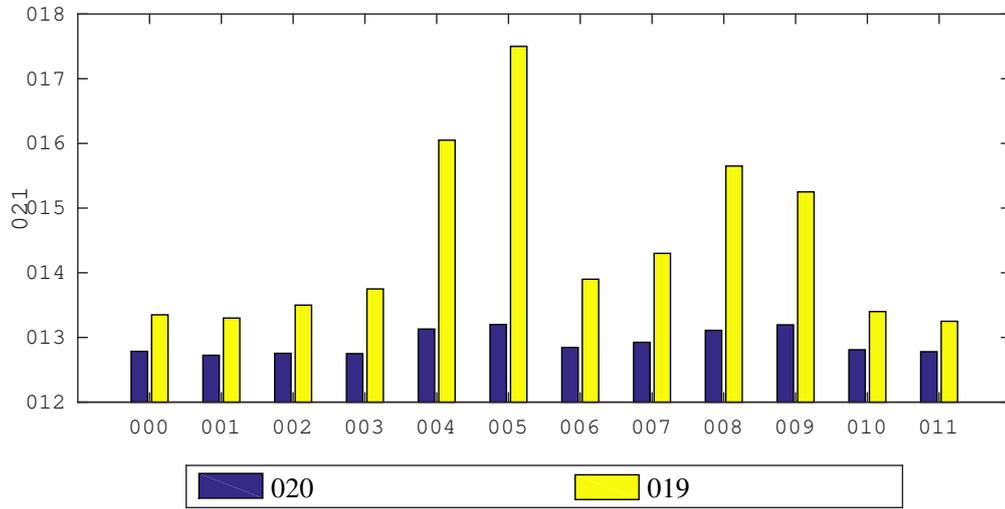

(a) Primary energy ratio.

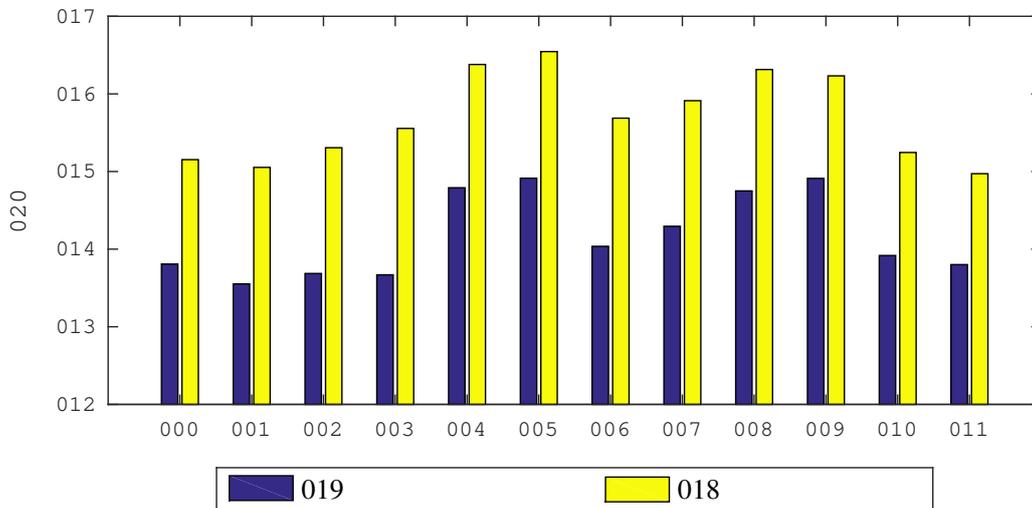

(b) Fraction savings.

Figure 10: Comparison of non-renewable primary energy ratios for the systems under study.


464 Due to the use of the same final energy for the two
 465 systems and the reference, the CO₂ emissions savings in
 466 percentage is the same as primary energy: 44% and 74%
 467 of the emissions along a year for the systems without
 468 the PV panels and with them, respectively. The abso-
 469 lute figures for the CO₂ emissions are shown in Table 4
 470 and they have been calculated with an emission factor
 471 for electricity production in Spain (detailed in Table 3).
 472 It must be pointed out that PER_{nRe} and $FSAV$ do not
 473 depend on the energy conversion factors.

474 5. Techno-economic analysis


475 Once the energy savings of both systems have been
 476 detailed in the previous section, the cost of the improve-
 477 ments is quantified. Consequently, the systems under
 478 study are the same as in the previous section.

479 The economic analysis takes into account the annual
 480 costs for investment, maintenance, residual value, re-
 481 placement and energy cost during the system lifetime.
 482 The annualized costs for the entire system are calculated
 483 by means of the annuity method. For each component
 484 the estimated lifetime, costs for investment and mainte-
 485 nance are calculated from real prices provided by three
 486 companies that work at local level (see Table 5). The
 487 maintenance cost for the PV panels has been quantified
 488 as 30 €/year, while 60 €/year is considered for the air
 489 conditioning unit, both for the reference model and the
 490 more efficient one used by the system. The period un-
 491 der consideration is 25 years, which is also the lifetime
 492 of the PV panels, while the air conditioning unit is con-
 493 sidered to last for 18 years only. An inflation rate of 3%
 494 and a market discount rate of 3% have been also consid-
 495 ered. Besides, the unit is paid with a 5 years credit with
 496 an interest rate of 5%. The energy cost of electricity is
 497 0.15 €/kWh and the power cost 90 €/kW.


498 Figure 11 shows the contribution of different con-
 499 cepts to the global cost of a system during its lifetime.
 500 For the reference system (less efficient), the highest cost
 501 is for the electricity (72.6%), while the investment is
 502 14.9% because the unit is cheaper. An efficient heat
 503 pump would require higher investment, which increases
 504 investment cost to 27.9% and replacement and residual
 505 cost to 6.9% of the total, while the electricity cost is re-
 506 duced to 54.7% due to lower consumption. If an invest-
 507 ment is made to purchase the PV panels, the electricity
 508 consumption decreases, but the investment cost and re-
 509 placement and residual cost raise to 42.2% and 7.3%
 510 respectively. The total cost and individual cost contri-
 511 butions for the three systems are depicted in Figure 12.
 512 As can be observed, the total annual cost for the two

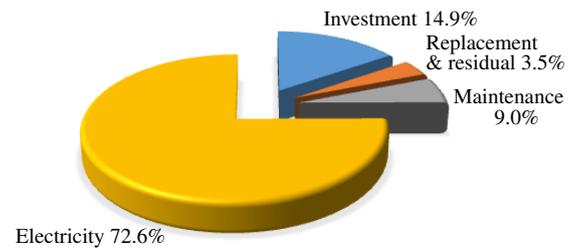

(a) Reference system.

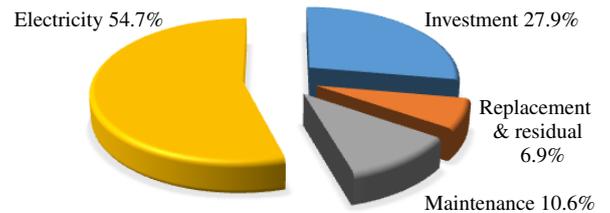

(b) Grid powered system.

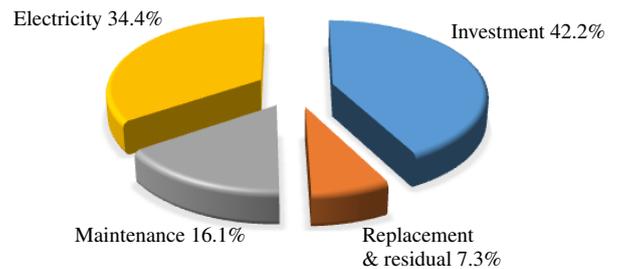

(c) PV + Grid powered system.

Figure 11: Total life system cost contributions.

Table 4: Primary non-renewable energy consumption and CO₂ emissions for the systems under consideration.

	PV + Grid powered	Grid powered	Reference unit
Produced thermal energy, Q [kWh/year]	6523	6523	6523
Consumed Grid Electricity, ETOT,unit [kWh/year]	678.8	1469.7	2609.0
Seasonal Performance Factor, SPF [-]	9.61	4.44	2.50
Primary non-renewable energy, PnRE [kWh/m ² year]	38.8	84.0	149.1
CO ₂ emissions [kg/m ² year]	6.92	15.0	26.6
Primary non-renewable ratio, PERnRE [-]	3.84	1.78	-
PnRE Savings Factor, FSAV [-]	74.0%	43.7%	-

Table 5: Techno-economic study results for a 25 years lifetime (Energy cost 0.15 €/kWh).

	PV + Grid powered	Grid powered	Reference
INVESTMENT	€	€	€
PV panels	1200	0	0
Air Conditioner	2600	2500	1500
INVESTMENT MATERIAL	3800	2500	1500
Design, planning and commissioning	200	200	200
General costs associated to works	760	500	300
Indirect costs and industrial benefits	190	125	75
TOTAL INVESTMENT COST	4950	3325	2075
REPLACEMENT COST	€/year	€/year	€/year
PV panels (25 years lifetime)	0	0	0
Air Conditioner (18 years lifetime)	39.27	37.76	22.65
TOTAL REPLACEMENT COST	39.27	37.76	22.65
MAINTENANCE	€/year	€/year	€/year
PV panels (30 €/year)	30	0	0
Air Conditioner (60 €/year)	60	60	60
TOTAL MAINTENANCE COST	90	60	60
OPERATION-ENERGY	€/year	€/year	€/year
Energy Cost of Electricity	101.81	220.46	391.36
Power Cost of Electricity	90	90	90
TOTAL ENERGY COST	191.81	310.46	481.36
ANNUALIZED COSTS	€/year	€/year	€/year
Investment	228.67	153.60	95.85
Replacement	39.27	37.76	22.65
Maintenance	87.38	58.25	58.25
Electricity	186.23	301.41	467.34
TOTAL ANNUALIZED COST	541.54	551.02	644.10
Cost ratio	0.84	0.86	-

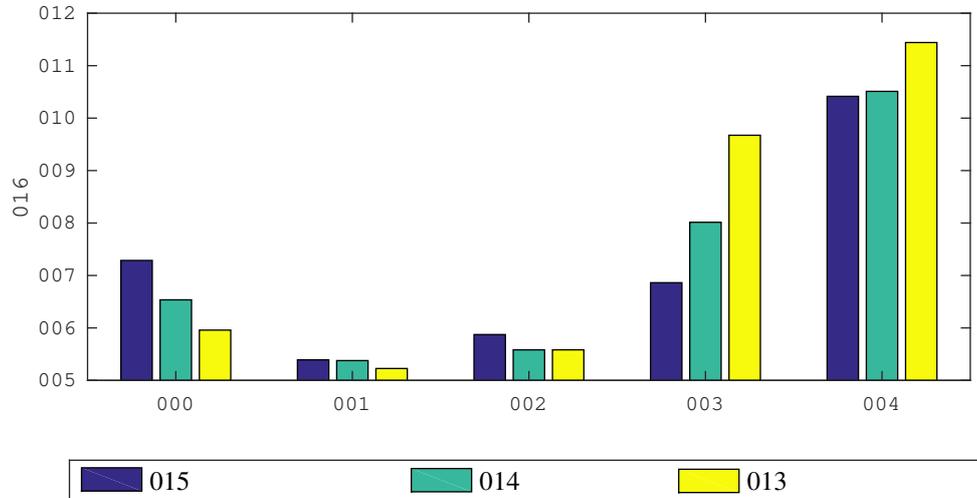


Figure 12: Individual annual cost contributions and total cost of the systems.

513 systems under study is quite similar, the cost of the refer- 542
 514 ence system being about 17-18% higher than them. 543

515 Even if there were no economic savings, the invest- 544
 516 ment in the efficient heat pump and the PV panels would 545
 517 be interesting due to the reductions in primary non- 546
 518 renewable energy consumption and CO₂ emissions. 547
 519 Then, the economic savings reinforce this conclusion.

520 However, the result of the former analysis depends 548
 521 strongly on the electricity price. To overcome this 549
 522 inconvenience, the same study has been carried out 550
 523 for electricity prices ranging from 0.10 €/kWh to 551
 524 0.3 €/kWh. Figure 13 shows the total cost of the three 552
 525 systems under consideration versus the electricity cost. 553
 526 Obviously, interest in the reference system increases for 554
 527 low electricity prices, as its higher energy consumption 555
 528 would be cheaper. This can be better observed if the 556
 529 cost ratio, CR , is used. It is calculated by comparing the 557
 530 total annualized cost of the system and that of the refer- 558
 531 ence system for the same space heating and cooling 559
 532 energy provided to the room:

$$CR = C_{AN}/C_{AN,ref} \quad (9)$$

533 As can be observed in Figure 14, almost no savings 563
 534 are achieved for the lowest energy price by the PV pow- 564
 535 ered efficient heat pump in comparison with the refer- 565
 536 ence. However, for 0.15 €/kWh_e, the annual cost of the 566
 537 system is only 84% of the reference system cost, being 567
 538 the more interesting, the higher the energy price. 568

539 By comparing the cost ratio for the efficient heat 569
 540 pump with and without the PV panels, their influ- 570
 541 ence is evaluated. As shown in the figure, from the 571

economic point of view, for low energy prices (be-
 low 0.15 €/kWh_e) the cost of the PV panels becomes
 slightly higher than the economic savings they produce.
 Nonetheless, as stated before, the environmental bene-
 fits are significant enough to justify this investment for
 all the prices in the range considered.

6. Conclusions

The work presents an air conditioning solution, con-
 sisting of an inverter heat pump powered by PV panels
 and the electrical grid. The system has been used to
 meet the thermal demand of an office during one year
 in a European city in the Mediterranean basin (Alicante,
 Spain).

Experimental measurements have been carried out
 during one year. Out of this data, the following working
 parameters have been quantified for such a period: solar
 irradiation, PV panels electricity production, PV panels
 maximum production, electricity consumption of the air
 conditioning unit from the grid and its thermal produc-
 tion. The results have been summarized as key perfor-
 mance indicators.

The PV panels directly connected to the AC unit have
 been found to produce 70% of its potential electricity
 production in comparison to the same model of PV pan-
 els connected to the grid. However, this solution does
 not increase the complexity of the building connection
 to the grid and avoids potential conflicts with local reg-
 ulation, by not supplying electricity to it.

The combined use of an efficient inverter heat pump
 with photovoltaic panels result in a significant reduc-

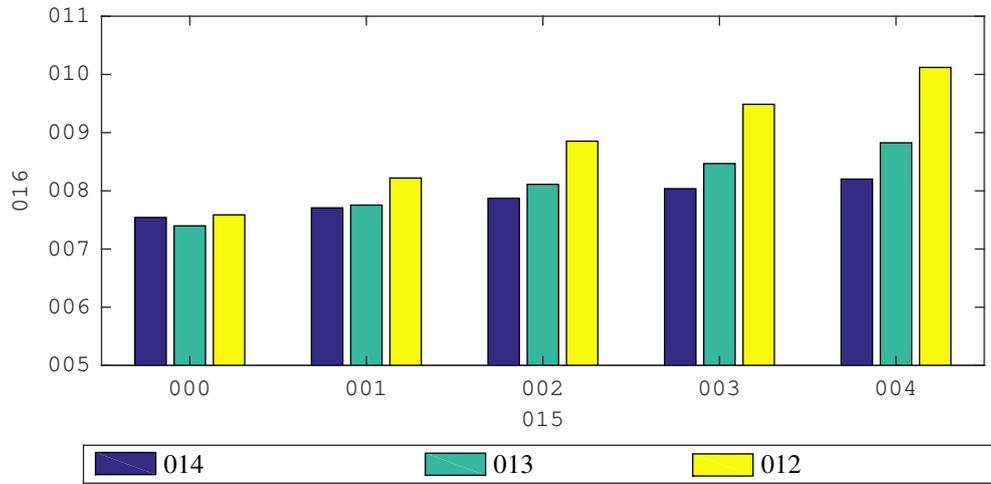


Figure 13: Influence of the electricity price on the total cost.

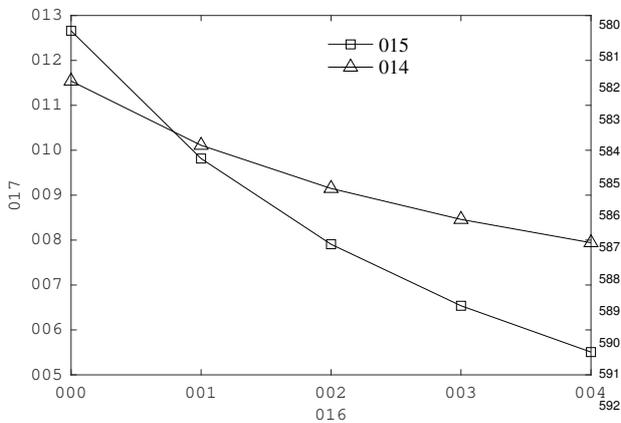


Figure 14: Cost ratio of the systems as a function of electricity price.

572 tion of the grid consumption during one year. The seasonal
 573 performance factor obtained for the system indicates that for each electrical energy unit consumed from the
 574 grid, 9.6 thermal energy units are produced within the office. The solar contribution of the PV panels to the
 575 electricity consumption of the AC unit has been quantified as 53.8%.
 576
 577
 578

579 Environmental and techno-economic studies have been carried out in order to quantify the environmental
 580 benefits and to evaluate the feasibility of the system. It has been found to reduce 74% of the primary non-
 581 renewable energy consumption and CO₂ emissions in comparison with the reference system. Furthermore its
 582 annual cost is 84% of the reference system cost, due to the reduction in electricity consumption.
 583
 584
 585
 586
 587

588 Moreover, the system provides a simple, feasible, safe and reliable solution based on renewable energy
 589 to drastically reduce CO₂ emissions and allow decarbonization within buildings, which is in agreement with
 590 the European and international roadmaps to stop the increase in the average Earth temperature.
 591
 592

References

- 594 Aguilar, F., Aledo, S., Quiles, P., 2017. Experimental analysis of an
595 air conditioner powered by photovoltaic energy and supported by
596 the grid. *Applied Thermal Engineering* 123, 486–497. doi:10.
597 1016/j.applthermaleng.2017.05.123.
- 598 Al-Alili, A., Hwang, Y., Radermacher, R., 2014. A hybrid solar
599 air conditioner: Experimental investigation. *International Journal*
600 *of Refrigeration* 39, 117–124. doi:10.1016/J.IJREFRIG.2013.
601 10.006.
- 602 Al-Ugla, A., El-Shaarawi, M., Said, S., Al-Qutub, A., 2016. Techno-
603 economic analysis of solar-assisted air-conditioning systems for
604 commercial buildings in Saudi Arabia. *Renewable and Sustainable*
605 *Energy Reviews* 54, 1301–1310. doi:10.1016/J.RSER.2015.
606 10.047.
- 607 Allouhi, A., Kousksou, T., Jamil, A., El Rhafiki, T., Mourad, Y.,
608 Zeraouli, Y., 2015. Economic and environmental assessment of solar
609 air-conditioning systems in Morocco. *Renewable and Sustainable*
610 *Energy Reviews* 50, 770–781. doi:10.1016/J.RSER.2015.
611 05.044.
- 612 Balaras, C.A., Grossman, G., Henning, H.M., Infante Ferreira, C.A.,
613 Podesser, E., Wang, L., Wiemken, E., 2007. Solar air condition-
614 ing in Europe—an overview. *Renewable and Sustainable Energy*
615 *Reviews* 11, 299–314. doi:10.1016/j.rser.2005.02.003.
- 616 Henning, H.M., 2007. Solar assisted air conditioning of buildings – an
617 overview. *Applied Thermal Engineering* 27, 1734–1749. doi:10.
618 1016/J.APPLTHERMALENG.2006.07.021.
- 619 Huang, B., Wu, J., Yen, R., Wang, J., Hsu, H., Hsia, C., Yen, C.,
620 Chang, J., 2011. System performance and economic analysis of
621 solar-assisted cooling/heating system. *Solar Energy* 85, 2802–
622 2810. doi:10.1016/j.solener.2011.08.011.
- 623 Huang, B.J., Hou, T.F., Hsu, P.C., Lin, T.H., Chen, Y.T., Chen, C.W.,
624 Li, K., Lee, K., 2016. Design of direct solar PV driven air condi-
625 tioner. *Renewable Energy* 88, 95–101. doi:10.1016/J.RENENE.
626 2015.11.026.
- 627 IDAE, 2016. Factores de emisión de CO₂ y coeficientes de paso a
628 energía primaria de diferentes fuentes de energía final consumi-
629 das en el sector de edificios en España. Documento Reconocido
630 del Reglamento de Instalaciones Térmicas en los Edificios (RITE).
631 Instituto para la diversificación y ahorro de la energía. Ministerio
632 de industria energía y turismo.
- 633 Izquierdo, M., Moreno-Rodríguez, A., González-Gil, A., García-
634 Hernando, N., 2011. Air conditioning in the region of Madrid,
635 Spain: An approach to electricity consumption, economics and
636 CO₂ emissions. *Energy* 36, 1630–1639. doi:10.1016/j.
637 energy.2010.12.068.
- 638 Li, Y., Zhang, G., Lv, G., Zhang, A., Wang, R., 2015. Performance
639 study of a solar photovoltaic air conditioner in the hot summer and
640 cold winter zone. *Solar Energy* 117, 167–179. doi:10.1016/J.
641 SOLENER.2015.04.015.
- 642 Li, Y., Zhao, B., Zhao, Z., Taylor, R., Wang, R., 2018. Performance
643 study of a grid-connected photovoltaic powered central air condi-
644 tioner in the South China climate. *Renewable Energy* 126, 1113–
645 1125. doi:10.1016/j.renene.2017.05.064.
- 646 Liu, Z., Li, A., Wang, Q., Chi, Y., Zhang, L., 2017. Performance study
647 of a quasi grid-connected photovoltaic powered DC air conditioner
648 in a hot summer zone. *Applied Thermal Engineering* 121, 1102–
649 1110. doi:10.1016/j.applthermaleng.2017.03.132.
- 650 Mugnier, D., Neyer, D., White, S.D. (Eds.), 2017. *The Solar Cooling*
651 *Design Guide - Case Studies of Successful Solar Air Conditioning*
652 *Design*. Wiley. doi:10.1002/9783433606841.
- 653 Opoku, R., Mensah-Darkwa, K., Samed Muntaka, A., 2018.
654 Techno-economic analysis of a hybrid solar PV-grid powered air-
655 conditioner for daytime office use in hot humid climates – A
656 case study in Kumasi city, Ghana. *Solar Energy* 165, 65–74.
657 doi:10.1016/j.solener.2018.03.013.
- 658 Passey, R., Watt, M., Bruce, A., MacGill, I., 2018. Who pays, who
659 benefits? The financial impacts of solar photovoltaic systems and
660 air-conditioners on Australian households. *Energy Research & Social*
661 *Science* 39, 198 – 215. doi:https://doi.org/10.1016/j.
662 ersss.2017.11.018.
- 663 Pérez-Lombard, L., Ortiz, J., Pout, C., 2008. A review on buildings
664 energy consumption information. *Energy and Buildings* 40, 394–
665 398. doi:10.1016/J.ENBUILD.2007.03.007.
- 666 Sampaio, P.G.V., González, M.O.A., 2017. Photovoltaic solar energy:
667 Conceptual framework. *Renewable and Sustainable Energy Re-*
668 *views* 74, 590–601. doi:10.1016/J.RSER.2017.02.081.
- 669 Tran, C., Rivière, P., Marchio, D., Arzano-Daurelle, C., 2012.
670 Refrigerant-based measurement method of heat pump seasonal
671 performances. *International Journal of Refrigeration* 35, 1583
672 – 1594. doi:https://doi.org/10.1016/j.ijrefrig.2012.
673 03.010.
- 674 Varga, S., Oliveira, A.C., Palmero-Marrero, A., Vrba, J., 2017. Pre-
675 liminary experimental results with a solar driven ejector air condi-
676 tioner in Portugal. *Renewable Energy* 109, 83–92. doi:10.1016/
677 J.RENENE.2017.03.016.
- 678 Xu, Y., Li, M., Luo, X., Ma, X., Wang, Y., Li, G., Hassanien, R.H.E.,
679 2018. Experimental investigation of solar photovoltaic operated
680 ice thermal storage air-conditioning system. *International Journal*
681 *of Refrigeration* 86, 258–272. doi:10.1016/j.ijrefrig.2017.
682 11.035.
- 683 Zouaoui, A., Zili-Ghedira, L., Ben Nasrallah, S., 2017. Solid desic-
684 cant solar air conditioning unit in Tunisia: Numerical study. *Inter-*
685 *national Journal of Refrigeration* 74, 662–681. doi:10.1016/J.
686 IJREFRIG.2016.11.013.

687 **List of Figures**

688	1	Sketch of the air conditioning system energy flows.	4
689			
690	2	AC unit power supply connection diagram.	4
691			
692	3	Experimental setup. Monitorization details.	6
693			
694	4	Electrical curves registered along one day in July: ($T_{out} = 30.2$ °C, $I = 7.61$ kWh/m ² , $LF = 61.0\%$).	6
695			
696			
697	5	Electrical curves registered along one day in Feb: ($T_{out} = 12.5$ °C, $I = 5.72$ kWh/m ² , $LF = 43.8\%$).	7
698			
699			
700	6	Total energy consumed $E_{TOT,unit}$ (electrical) and produced Q (thermal) by the air conditioning unit. Seasonal performance factor of the unit (right axis). . .	8
701			
702			
703			
704	7	Electrical consumption ($E_{TOT,unit}$) broken down according to the energy source: the grid ($E_{GD,unit}$) or the PV panels ($E_{PV,unit}$)	9
705			
706			
707			
708	8	Solar fraction SF , Performance factor PF and Load factor LF	9
709			
710	9	Seasonal performance factor for the unit (SPF_{unit}) and the system (SPF_{sys}). . . .	11
711			
712	10	Comparison of non-renewable primary energy ratios for the systems under study. . .	12
713			
714	11	Total life system cost contributions. . .	13
715	12	Individual annual cost contributions and total cost of the systems.	15
716			
717	13	Influence of the electricity price on the total cost.	16
718			
719	14	Cost ratio of the systems as a function of electricity price.	16
720			